

ಇವರಿಗೆ,

ಸಹಾಯಕ ಕಾರ್ಯನಿರ್ವಾಹಕ ಇಂಜಿನಿಯರ್ (ಎ),
ವಾ.ಕಾ. ಮತ್ತು ಪಾಲನಾ ವಿಭಾಗ,
ಬೆ.ವಿ.ಕಂ. ಹೊಳಲ್ಕೆರೆ.

ಇಂದ:

ಮಾರುತಿ ಸ್ಟೋನ್ ಕ್ರಷರ್,
ಹರೇನಹಳ್ಳಿ,
ಹೊಳಲ್ಕೆರೆ ತಾಲ್ಲೂಕು, ಚಿತ್ರದುರ್ಗ ಜಿಲ್ಲೆ.

ಮಾನ್ಯರೇ,



ವಿಷಯ: ವಿದ್ಯುತ್ ಸಂಪರ್ಕವನ್ನು ಶಾಶ್ವತವಾಗಿ ಸ್ಥಗಿತಗೊಳಿಸುವ ಬಗ್ಗೆ.

ಈ ಮೇಲ್ಕಂಡ ವಿಷಯಕ್ಕೆ ಸಂಬಂಧಿಸಿದಂತೆ ಆರ್.ಆರ್. ಸಂಖ್ಯೆ: 11, ಅಂಬುಜಮ್ಮ ಕೇರಾಫ್ ಮಾರುತಿ ಸ್ಟೋನ್ ಕ್ರಷರ್‌ನ್ನು ಹರೇನಹಳ್ಳಿ ಗ್ರಾಮ, ಹೊಳಲ್ಕೆರೆ ತಾಲ್ಲೂಕು ಇಲ್ಲಿ ಕ್ರಷರ್ ನಡೆಸುತ್ತಿದ್ದು, ವಿದ್ಯುತ್‌ಚಕ್ತಿ ಬಿಲ್ ಇಲ್ಲಿಯತನಕ ಸುಮಾರು ರೂ.21,90,760-00 ಗಳನ್ನು ಮಾರ್ಚಿ 2025ರ ತನಕ ಬಾಕಿ ಇರುತ್ತದೆ. ನಾವುಗಳು ಈಗ ಬಾಕಿ ಇರುವ ಸಂಪೂರ್ಣ ಮೊತ್ತವನ್ನು ಪಾವತಿ ಮಾಡಿರುತ್ತೇವೆ ಯಾವುದೇ ಬಾಕಿ ಇರುವುದಿಲ್ಲ. ನಮ್ಮ ಕ್ರಷರ್‌ನಲ್ಲಿ ಯಾವುದೇ ವ್ಯವಹಾರಗಳು ನಡೆಯದ ಕಾರಣ ವಿದ್ಯುತ್‌ಚಕ್ತಿಯ ಅವಶ್ಯಕತೆಯ ಇರುವುದಿಲ್ಲ.

ಆದ್ದರಿಂದ ತಾವುಗಳು ದಯಮಾಡಿ ಆರ್.ಆರ್. ಸಂಖ್ಯೆ 11 ರ ವಿದ್ಯುತ್ ಸಂಪರ್ಕವನ್ನು ಶಾಶ್ವತವಾಗಿ ಸ್ಥಗಿತಗೊಳಿಸಬೇಕೆಂದು ಈ ಮೂಲಕ ತಮ್ಮಲ್ಲಿ ಮನವಿ ಮಾಡಿಕೊಳ್ಳುತ್ತೇನೆ.

ವಂದನೆಗಳೊಂದಿಗೆ,

ತಮ್ಮ ವಿಶ್ವಾಸಿ,

ಸ್ಥಳ : ಹೊಳಲ್ಕೆರೆ

ದಿನಾಂಕ : 22-04-25

ಅಂಬುಜಮ್ಮ
(ಅಂಬುಜಮ್ಮ)

AE/HLK
ಸ್ಥಳೀಯ ನಿರ್ದೇಶಕರೇ
ನಿರ್ದೇಶಕರೇ
22/4


ನಿರ್ದೇಶಕರೇ ಸ್ಥಳೀಯ ನಿರ್ದೇಶಕರೇ
- ಕೆ.ಎ.ನೇಶ್ವರ HLG HT II, ಬೊರಿಸಿ stone
concrete ಸ್ಥಳೀಯ ನಿರ್ದೇಶಕರೇ
ಬಳಸಿಕೊಳ್ಳುತ್ತಿರುವ valant ನಿರ್ದೇಶಕರೇ.

ಸಹಾಯಕ ಇಂಜಿನಿಯರ್ (ಎ)
ಬೆ.ವಿ.ಕಂ. ಹೊಳಲ್ಕೆರೆ ಶಾಖೆ. 24/4/25





BESCOM METERING

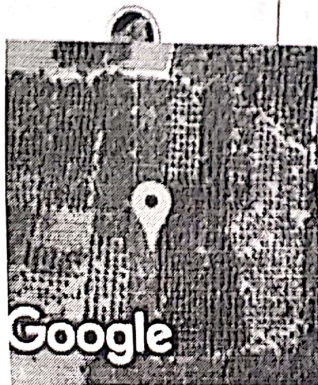

VYOMA SWITCHGEAR
PH: 28392416 28390808 28378259
TEL: FAX: 28390763

Chatnahalli, Karnataka, India
35pq+mw8, Chatnahalli, Karnataka 577526, India
Lat 14.088111° Long 76.190326°
24/04/2025 04:47 PM GMT +05:30

GPS Map Camer

COMPACTING MAIN UNITS, LOAD BREAK SWITCHING PANEL,
VACUUM CIRCUIT BREAKER PANELS, AIR CONDITION
PANELS, 24 PHASE OPP. ASIAN PAINTS, DEENPA INDUSTRIAL
BANGALORE



BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED

(Wholly owned Government of Karnataka undertaking)

No: AEE/HTR/DVG/2025-26/02
 Email: aeehtr.bescomdvg@gmail.com
 Cell : 9448279331
 Date: 5.5.25

Office of the
 Assistant Executive Engineer (Ele)
 HT Rating Sub-division, BESCOM
 Davangere.

To,
 The Assistant Executive Engineer (Ele),
 O&M Sub-Division,
 BESCOM,
 Sir, Holalkere

HTC	3CT 3PT
M/S	Vyoma S/W
No.	190323 K922
GPS	

Sub: Rating of HT/EHT installation bearing RR No: HLKHT-10
 Ref:

The HT installation having the following details has been rated for Periodical/Complaint/Request on 5/5/25. You are requested to take action on the observations and advise recorded in the Report enclosed herewith, Compliance report shall be sent to this office for the action taken at your end.

1. DETAILS OF HT INSTALLATION:

a. RR NO	HLKHT-10	d. Tariff	HT-2 (C)
b. CD	40	e. Last rated	18.1.25
c. MC	250 (2.5/1A)	f. Nature	

2. NAME AND ADDRESS OF THE CONSUMER: The principal P.U Science College, M.D. PU College, Chitrahalli

3. OBSERVATION & ADVICE ON TECHNICAL MATTER: Periodical/Complaint Rating of the HT installation is carried out and the performance of the HT metering error is found to be within permissible limits. Technical Data's in this Report shall update in your office records. Any variations found, shall inform to this office.

4. ADVICE ON REVENUE MATTER: 1) Verify CD / MF / Tariff & Billing readings stopped 12.5.25 33.33% up according to bill

5. DETAILS OF SEALS:

Sl No	Seals Provided to	Seal Found	Seal Left	1 Make	Secure/L&TC
1	MC L967867	+19212+09	5450	2 Type WR	3008211KUP
2	RS	15055	Retained	3 Version	Legacy/DLMS/TOD
3	TC	145912	-	4 Class	0.5S/0.2S, NTD:
4	TTB	187637	188819	5 Voltage	2x110V, 3x63.5V
5	MBD	187638	188820	6 Ampere	5A, 1A
6	CT/PT	187639	188821	7 Phase	3P/3W, 3P/4W
7	I/C	187643	188823	8 Pulse/Unit	16000/10000/50000
8	O/G	187642	188822	9 MF/YOM	01/12/18
9				10 Sl No	1883129

6. DETAILS OF CTS & PTS:

Sl No	Specification	Existing CT	Replaced CT	Existing PT	Replaced PT
1	Make	Kalpa/Intrans/Vyoma	Vyoma	Kalpa/Intrans/Vyoma	
2	Type	Resign Cast	Resign Cast	Resign Cast	
3	Class	0.2/0.5/1.0	0.25	0.2/0.5/1.0	
4	Insulation Level	75/38/95kV	75/38/95kV	75/38/95kV	
5	Burden	2.5/3.75VA	2.5VA	25/50VA	
6	Ratio Available	2.5/1A	2.5/1A	11kV/110V	
7	Ratio Connected	2.5/1A	2.5/1A	11kV/110V	
8	Sl No: 'R' Ph	Vyoma-150			
	'Y' Ph	Vyoma-9759	Vyoma-P-5092		
	'B' Ph	Vyoma-151	Vyoma-P-5093		

MODEM Make:	Analogic/N-soft	MODEM Sl No:	NSGW 703231
Modem Model:	ACA30626/4G	SIM No:	

ANNEXURE-I

R.R No:.....

7. MULTIPLICATION CONSTANT FOR BILLING:

Ex. CTR:	2.519	Ex. PTR:	11KV/110V	Ex. CTR X PTR =	
New CTR:		Ex. PTR:	11KV/110V	New.MF= CTR X PTR =	250

8. CALIBRATION DETAILS:

SI No	DATR DESCRIPTION	CALIBRATORY VALUES	METER VALUES
1	Voltages: U1, U2, U3	61.07 61.51 61.85	58.01 60.55
2	Current: A1, A2, A3	0.000 0.000 0.000	0.057 0.078
3	Pr. Kw/Kvar/Kva/PF	0.0008 0.0002 0.0009 0.982	0.0128 0.0024 0.012
4	Sequence FO/RE	FO/RE ✓	RE
5	Test Meter Reading	10.10	10.10
6	Reference Meter Reading		
7	Percentage error found & left	-33.33% less	+0.067.06

9. METER RECORDED DATA's / READINGS:

SI No	METER READING	EXISTING BEFORE RESET	REPLACED / AFTER RESET	Remarks
1	Date/Time	5.5.25 / 12:29	13:24	Y& B ph city
2	ACTIV BILLING VALUES			replaced by good one.
	b ¹ Kwh	380.45		
	b ² Kwh	378.64		
	b ¹ KVAh	444.73		33.33% less word
	b ¹ PF	0.850		no shall be stopped
	b ¹ KVA	0.0218		San 05.05-25
				with Chk: 380.74.
3	MD Re-set counter (RC)	79		
4	TOD BILLING VALUES (KWh)			
	TOD-1 - b ¹ ₁ or b ¹ ₀ or R ₁			
	TOD-2 - b ¹ ₂ or b ¹ ₁ or R ₂			
	TOD-3 - b ¹ ₃ or b ¹ ₂ or R ₃			
	TOD-4 - b ¹ ₄ or b ¹ ₃ or R ₄			
5	ACTIVE CUMULATIVE VALUES	BEFORE Re-set	AFTER Re-set	TOD-CUMULATIVE VALUES
	C Kwh	380.74		BEFORE AFTER
	C KVAh Lag/Lead	165.09 9.95		C ₁ Kwh-
	C KVAh	445.05		C ₂ Kwh-
	C ¹ /CMD KVA	2.35		C ₃ Kwh-
				C ₄ Kwh-
6	Recent / Utility: U/r KVA / r PF	0.000 0.900		
7	MD Re-set Manual/Automatic			
	TOD TIMINGS:			
	b ¹ ₁ : 06 to 9 Hr	b ¹ ₂ : 9 to 18 Hr	b ¹ ₃ : 18 to 22 Hr	b ¹ ₄ : 22 to 06 Hr

Consumer/Representative
Signature with Seal

Copy Submitted for kind information to:

- 1) The Executive Engineer (Ele), M.T Division, BESCOM, Chitradurga Zone, Chitradurga.
- 2) The Executive Engineer (Ele), O&M Division, BESCOM, Davanagere/Harihara/Chitradurga/Hiriyuru.
- 3) The Account Officer, (I/A), O&M Division, BESCOM, Davanagere/Harihara/Chitradurga/Hiriyuru.
- 4) Copy to the Customer:
- 5) HTMF/RR No:.....HLKHT. 10

Your faithfully,

Assistant/Executive Engineer(Ele),
HT Rating Sub-Division, BESCOM,
Davanagere.





BANGALORE ELECTRICITY SUPPLY COMPANY LIMITED

(Wholly owned Government of Karnataka undertaking)

No: AEE/HTR/DVG/2023-26/01
Email: aeehtr.bescomdvg@gmail.com
Cell : 9448279331
Date: S.5.25

Office of the
Assistant Executive Engineer (Ele)
HT Rating Sub-division, BESCOM
Davangere.

To,
The Assistant Executive Engineer (Ele),
O&M Sub-Division.....
BESCOM,
Sir, Holakere

HTC	3CT 3PT
M/S	Vyoma SLW
No.	190824 K662
GPS	

Sub: Rating of HT/EHT installation bearing RR No: HLKHT-11
Ref: AEE/AECT/HLK/195/03.05.25

The HT installation having the following details has been rated for Periodical/Complaint/Request on herewith, Compliance report shall be sent to this office for the action taken at your end.

1. DETAILS OF HT INSTALLATION:

a.	RR NO	<u>HLKHT-11</u>	d.	Tariff	<u>HT-2 (a) TOD</u>
b.	CD	<u>660</u>	e.	Last rated	<u>34.1.25</u>
c.	MC	<u>3000 (30/1A)</u>	f.	Nature	<u>Stone crusher</u>

2. NAME AND ADDRESS OF THE CONSUMER: Smt Ambutamma

M/s Maruthi Stone Crusher & Harenahalli

3. OBSERVATION & ADVICE ON TECHNICAL MATTER: Periodical/Complaint Rating of the HT installation is carried out and the performance of the HT metering error is found to be within permissible limits. Technical Data's in this Report shall update in your office records. Any variations found, shall inform to this office.

4. ADVICE ON REVENUE MATTER: 1) Verify CD / MF / Tariff & Billing readings
As per revenue bills the installation is rated.
and permanent disconnection.

5. DETAILS OF SEALS:

Sl No	Seals Provided to	Seal Found	Seal Left	1 Make	Secure/L&T
1	MC C427984	+ BME 06203	+ 097806	2 Type UR	3000011K4R3
2	RS	50182	Retained	3 Version	Legacy/DLMS/TOD
3	TC	145902	-	4 Class	0.5S/0.28; NTD:
4	TTB	187715	-	5 Voltage	2x110V, 3x63.5V
5	MBD	187716	PPE	6 Ampere	5A, 1A
6	CT/PT	50186	PPC	7 Phase	3P/3W, 3P/4W
7	I/C	145905	Retained	8 Pulse/Unit	16000/10000/50000
8	O/G	LBS	-	9 MF/YOM	01/7/19
9				10 Sl No	19005083

6. DETAILS OF CTS & PTS:

Sl No	Specification	Existing CT	Replaced CT	Existing PT	Replaced PT
1	Make	Kalpa/Instrans/Vyoma		Kalpa/Instrans/Vyoma	
2	Type	Resign Cast		Resign Cast	
3	Class	0.2/0.5/1.0		0.2/0.5/1.0	
4	Insulation Level	15/38/95kV		15/35/95kV	
5	Burden	2.5/3.75VA		25/50VA	
6	Ratio Available	30/1A		11kV/110V	
7	Ratio Connected	30/1A		11kV/110V	
8	Sl No: 'R' Ph	Uyc 1697		Uypk 9585	
	'Y' Ph	Uyc 1696		Uypk 9584	
	'B' Ph	Uyc 1695		Uypk 9583	

MODEM Make:	Analogic/N-soft	MODEM Sl No:	Uyc 1697 703983
Modem Model:	ACA30626/4G	SIM No:	Active



ANNEXURE-I

R.R No:.....

7. MULTIPLICATION CONSTANT FOR BILLING:

Ex. CTR:	301A	Ex. PTR:	11KV/110V	Ex. CTR X PTR =	3000
New CTR:	-	Ex. PTR:	11KV/110V	New.MF= CTR X PTR =	-

8. CALIBRATION DETAILS:

SI No	DATR DESCRIPTION	CALIBRATORY VALUES	METER VALUES
1	Voltagess: U1, U2, U3	62.62 63.09 63.23	
2	Current: A1, A2, A3	0.000 0.000 0.000	
3	Pr. Kw/Kvar/Kva/PF	0.0003 0.0012 0.0012	0.309
4	Sequence FO/RE	FO/RE	no load current
5	Test Meter Reading		
6	Reference Meter Reading		
7	Percentage error found & left		

9. METER RECORDED DATA's / READINGS:

SI No	METER READING	EXISTING BEFORE RESET	REPLACED / AFTER RESET	Remarks
1	Date/Time	5.5.25 11:58		
2	ACTIV BILLING VALUES			
	b ¹ Kwh	289.79		
	b ² Kwh	289.79		
	b ¹ KVAh	417.81		
	b ¹ PF	-		
	b ¹ KVA	0.0000		
3	MD Re-set counter (RC)	72		
4	TOD BILLING VALUES (KWh)			
	TOD-1 - b ¹ ₁ or b ¹ ₀ or R ₁	25.73 25.73	0.0000	-
	TOD-2 - b ¹ ₂ or b ¹ ₁ or R ₂	44.23 44.23	0.0000	-
	TOD-3 - b ¹ ₃ or b ¹ ₂ or R ₃	52.41 52.41	0.0000	-
	TOD-4 - b ¹ ₄ or b ¹ ₃ or R ₄	167.40 167.40	0.0000	-
5	ACTIVE CUMULATIVE VALUES	BEFORE Re-set	AFTER Re-set	TOD-CUMULATIVE VALUES
	C Kwh	289.79		BEFORE AFTER
	C KVarh Lag/Lead	254.69 24.87		C ₁ Kwh- 25.73
	C KVAh	417.82		C ₂ Kwh- 44.23
	C ¹ /CMD KVA	4.27		C ₃ Kwh- 52.41
				C ₄ Kwh- 167.40
6	Recent / Utility: U/r KVA / r PD	0008 0.500		
7	MD Re-set Manual/Automatic			
	TOD TIMINGS:			
	b ¹ ₁ : 06 to 9 Hr	b ¹ ₂ : 9 to 18 Hr	b ¹ ₃ : 18 to 22 Hr	b ¹ ₄ : 22 to 06 Hr

Your faithfully,

Consumer/Representative
Signature with Seal

Pravin R
S/O HLK

[Signature]
Assistant Executive Engineer (Ele),
HT Rating Sub-Division, BESCOM,
Davanagere.

Copy Submitted for kind information to:

- 1) The Executive Engineer (Ele), M.T Division, BESCOM, Chitradurga Zone, Chitradurga.
- 2) The Executive Engineer (Ele), O&M Division, BESCOM, Davanagere/Harihara/Chitradurga/Hiriyuru.
- 3) The Account Officer, (I/A), O&M Division, BESCOM, Davanagere/Harihara/Chitradurga/Hiriyuru.
- 4) Copy to the Customer:
- 5) HTMF/RR No:..... HLKHT- 11

